

ET-6C

End Termination Kit

INSTALLATION PROCEDURES

To be used in conjunction with Thermon connection kits

**MADE IN
USA**



The Heat Tracing Specialists®

ET-6C


The ET-6C Kit is used for end circuit termination of BSX, RSX, and VSX self-regulating heating cables.

Kit Contents . . .




Item	Quantity	Description
1	1	End Cap
2	1	RTV Tube


Tools Required . . .

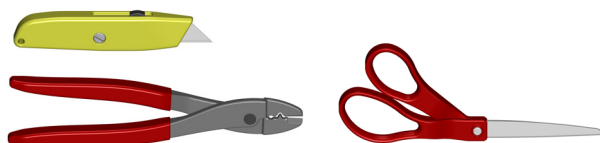


Installation Instructions for BSX, RSX, VSX

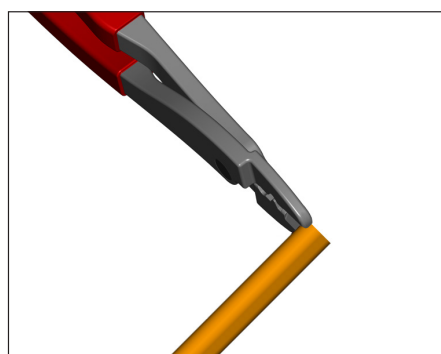


1. Cut off end of cable.

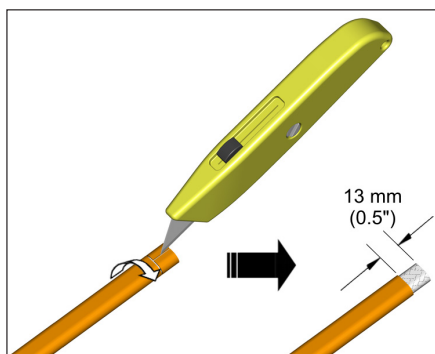

2. Cut and remove overjacket.

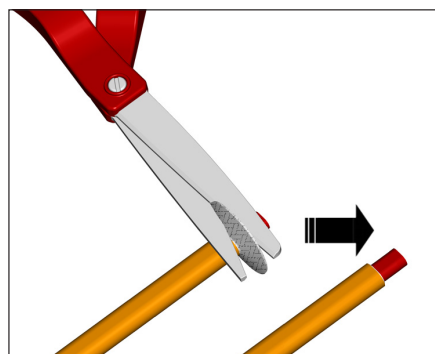


3. Trim away exposed braid from cable.

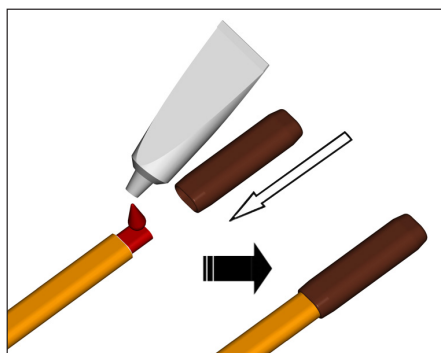

4. Fill the end cap with RTV sealant and apply a circumferential bead to cable [minimum of 3 mm (0.12") wide]. Slide end cap onto end of cable.

Cable Take-off for BSX, RSX, TSX, VSX

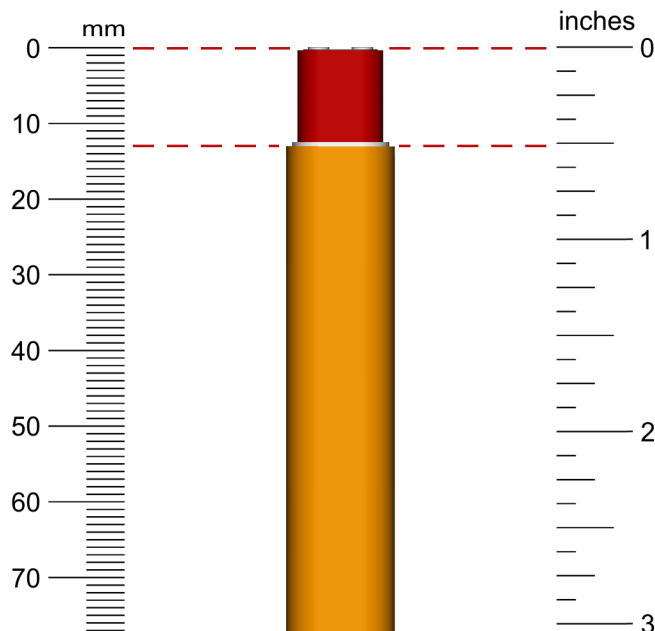

Warnings . . .

- Due to the risk of electrical shock, arcing and fire caused by product damage or improper usage, installation or maintenance, a ground-fault protection device is required.
- Installation must comply with Thermon requirements (including form PN 50207 for Ex systems) and be installed in accordance with the NEC, CEC, or any other applicable national and local codes.
- Component approvals and performance ratings are based on the use of Thermon specified parts only.
- Keep ends of heating cable and kit components dry before and during installation.
- Store in a dry location.

Certifications/Approvals¹ . . .



IP66 NEMA/Type 4X

Ordinary & Hazardous Locations

Listed Heat Tracing Cable System 137M

Certifications vary by cable type. See product specification sheets for additional information.



THERMON . . . The Heat Tracing Specialists®

Corporate Headquarters
100 Thermon Dr. • PO Box 609
San Marcos, TX 78667-0609
Phone: +1 512-396-5801

For the Thermon office
nearest you visit us at . .
www.thermon.com

Specifications and information are subject to change without notice. Form PN50085-0614

ISO 9001
REGISTERED